



REINFORCED CONCRETE PIPE CULVERTS AND END SECTIONS
(Round Pipe)

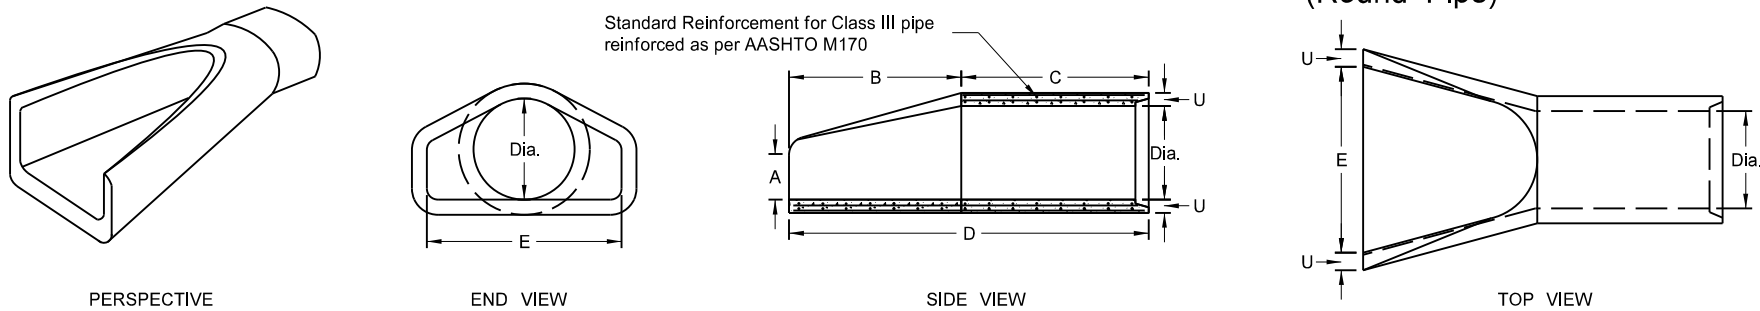

REINFORCED CONCRETE PIPE - FLARED END SECTION
Reinforcement to be equivalent to Class III RCP

TRAVERSABLE END SECTION							
DIA	B	C	D	E	F	R	S
15"	4"	9"	4'-9"	1'-7½"	2½"	3"	6
18"	5'-9"	9"	6'-6"	1'-11"	2½"	3"	6
24"	6"	1'	7"	2'-6"	3"	3"	4
30"	7'-6"	1'	8'-6"	3'-1"	3½"	3½"	4
36"	7'-3"	15"	8'-6"	3'-8"	4"	3"	4

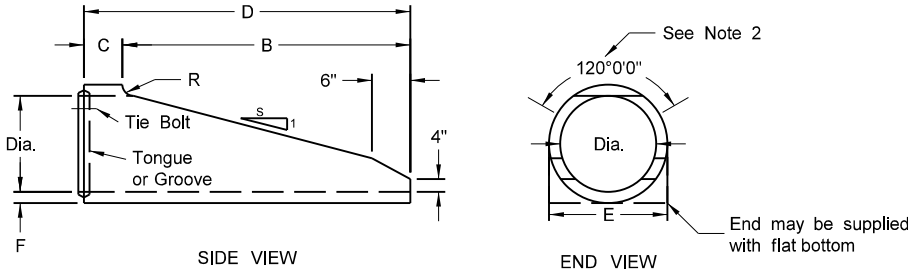


NOTES (Traversable End Section):

1. Manufactured in accordance with applicable portions of ASTM C76/AASHTO M170.
2. Reinforcement per Class III RCP with double reinforcement in the upper 120° of the full barrel portion.

FLARED END SECTION						
TERMINAL DIMENSIONS						
DIA	A	B	C	D	E	U
12	0'-4"	2'-0"	4'-0⅞"	6'-0⅞"	2'-0"	2"
15	0'-6"	2'-3"	3'-10"	6'-1"	2'-6"	2½"
18	0'-9"	2'-3"	3'-10"	6'-1"	3'-0"	2½"
21	0'-9"	3'-0"	3'-1"	6'-1"	3'-6"	2½"
24	0'-9½"	3'-7½"	2'-6"	6'-1½"	4'-0"	3"
27	0'-10½"	4'-0"	2'-1½"	6'-1½"	4'-6"	3½"
30	1'-0"	4'-6"	1'-7¾"	6'-1¾"	5'-0"	3½"
36	1'-3"	5'-3"	2'-9"	8'-0"	6'-0"	4"
42	1'-9"	5'-3"	2'-9"	8'-0"	6'-6"	4½"
48	2'-0"	6'-0"	2'-0"	8'-0"	7'-0"	5"
54	2'-3"	5'-5"	2'-9¼"	8'-2¼"	7'-6"	5½"
60	2'-11"	5'-0"	3'-3"	8'-3"	8'-0"	5"
66	2'-6"	6'-0"	2'-3"	8'-3"	8'-6"	5½"
72	3'-0"	6'-6"	1'-9"	8'-3"	9'-0"	6"
78	3'-0"	7'-6"	1'-9"	9'-3"	9'-6"	6½"
84	3'-0"	7'-6½"	1'-9"	9'-3½"	10'-0"	6½"
90	3'-5"	7'-3½"	2'-0"	9'-3½"	11'-0"	6½"

REINFORCED CONCRETE PIPE - TRAVERSABLE END SECTION
Reinforcement to be equivalent to Class III RCP

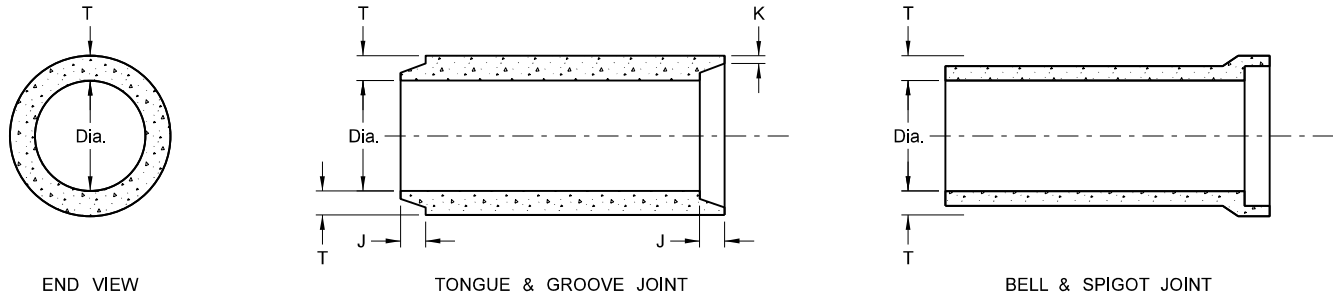

All Classifications of Round Concrete Pipe					
Internal Dia. of Pipe in Inches	Cross-Sectional Water Area	Weight per Lin. Foot of Pipe Std. Wall	Joint J Groove End Min./Max.	Joint K Tongue Min.	Minimum Wall Thickness (T)
Dia	Sq. ft.	Lbs.	In.	In.	In.
12	0.79	92	1⅞-2⅝	¾	2
15	1.23	127	1¾-2¾	⅞	2½
18	1.77	168	1⅞-2⅞	1	2½
21	2.40	214	1⅞-3⅞	1⅞	2¾
24	3.14	265	2¾-3¾	1⅞	3
27	3.98	322	2¾-4	1¼	3¼
30	4.91	384	3¼-4¼	1¼	3½
33	5.94	452	3¼-4¼	1½	3¾
36	7.07	524	3¼-4¼	1½	4
42	9.62	685	3¼-4¾	1¼	4½
48	12.57	685	3⅞-4¾	1⅞	5
54	15.90	1070	4⅞-5⅞	2	5½
60	19.63	1296	4⅞-5½	2¼	6
66	23.76	1542	5-6	2⅞	6½
72	28.27	1810	5⅞-6¾	2⅞	7
78	33.18	2098	6¼-7¼	2⅞	7½
84	38.48	2410	5⅞-7¾	3⅞	8
90	44.18	2793	6¾-8½	3⅞	8½
96	50.27	3092	7-8¼	3½	9
102	56.75	3466	7-8¼	3½	9½
108	63.62	3864	7¼-8½	3¾	10

NOTES:

1. All reinforcing steel shall meet AASHTO M170 requirements.
2. All circular, longitudinal, and elliptical reinforcement shall be assembled and securely fastened in cage fashion so as to maintain reinforcement in exact shape and correct positions within the forms.
3. Laying length of pipe: 12" to 66" (incl.) = not less than 4 feet 66" to 108" (incl.) = not less than 6 feet
4. Joints shall be sealed with rubber gaskets or with sealer approved by the engineer whenever pipe are specified for storm drain or sanitary sewers.
5. For Class IV and Class V reinforced concrete pipe and end section sizes which do not have reinforcement specified by AASHTO M170, shop drawings and design calculations shall be prepared and sealed by a Professional Engineer and submitted for the Engineer's review.

SEE STANDARD DRAWING D-714-22 FOR DETAILS OF CONCRETE PIPE TIES (TIE BOLTS).

NORTH DAKOTA DEPARTMENT OF TRANSPORTATION	
05-12-14	
REVISIONS	
DATE	CHANGE
01-21-15	Revised Note 5

This document was originally issued and sealed by Terrence R. Udland, Registration Number PE- 2674, on 01/21/15 and the original document is stored at the North Dakota Department of Transportation